

HIGH EFFICIENCY, HIGH DENSITY, DUAL-OUTPUT
(3.3V/5A and 2.5V/5A) REGULATOR

DESCRIPTION

Demonstration circuit 1586A is a high efficiency, dual-output (3.3V and 2.5V), synchronous buck converter with 4.5V to 25V input range. It can supply 5A maximum load current at 3.3V and 2.5V outputs. The demo board uses the LTC3855EUJ controller. The LTC3855 is a feature-rich dual-output dual-phase synchronous buck controller with on-chip drivers, remote output voltage sensing (V_{OUT2}) and inductor DCR temperature compensation. It is suitable for input from 4.5V to 38V and output up to 12.5V. The LTC3855 can provide high efficiency, high power density and versatile power solutions for telecom and datacom systems, industrial and medical instruments, DC power distribution systems and computer systems. The controller is available in 40-pin 6mm × 6mm QFN and 38-pin TSSOP packages.

The RUN pins (JP1 and JP4) provides enable feature. To shut down the converter, one simple way is to force the RUN pins below 1.2V (JP1: OFF; JP4: OFF). Use JP2 jumper to select burst mode, pulse skipping mode or forced continuous mode operation. The phase of CLKOUT is set by JP3. Switching frequency is pre-set at about 500kHz, and it can be easily modified from 250kHz to 770kHz. Please see LTC3855 datasheet for detailed information.

Design files for this circuit board are available. Call the LTC factory.

Table 1. Performance Summary (T_A = 25°C)

PARAMETER	CONDITION	VALUE
Input Voltage Range		4.5V to 25V
Output Voltage, V _{OUT1}	V _{IN} = 4.5-25V, I _{OUT1} = 0A to 5A	3.3V ±2%
Output Voltage, V _{OUT2}	V _{IN} = 4.5-25V, I _{OUT2} = 0A to 5A	2.5V ±2%
Maximum Output Current, I _{OUT1}	V _{IN} = 4.5-25V, V _{OUT1} = 3.3V	5A
Maximum Output Current, I _{OUT2}	V _{IN} = 4.5-25V, V _{OUT2} = 3.3V	5A
Typical Efficiency for V _{OUT1}	V _{IN} = 12V, V _{OUT1} = 3.3V, I _{OUT1} = 5A	92.1%
Typical Efficiency for V _{OUT2}	V _{IN} = 12V, V _{OUT2} = 2.5V, I _{OUT2} = 5A	90.3%
Typical Switching Frequency		500kHz

QUICK START PROCEDURE

Demonstration circuit 1586A is easy to set up to evaluate the performance of the LTC3855EUJ. Refer to Figure 1 for the proper measurement equipment setup and follow the procedure below:

1. With power off, connect the input power supply to Vin (4.5V-25V) and GND (input return).
2. Connect the 3.3V output load between Vout1 and GND (Initial load: no load).
3. Connect the 2.5V output load between Vout2 and GND (Initial load: no load).
4. Connect the DVMs to the input and outputs.
5. Turn on the input power supply and check for the proper output voltages. Vout1 should be 3.3V $\pm$ 2%. Vout2 should be 2.5V $\pm$ 2%.
6. Once the proper output voltages are established, adjust the loads within the operating range and observe the output voltage regulation, ripple voltage and other parameters.

Note: When measuring the output or input voltage ripple, do not use the long ground lead on the oscilloscope probe. See Figure 2 for the proper scope probe technique. Short, stiff leads need to be soldered to the (+) and (-) terminals of an output capacitor. The probe's ground ring needs to touch the (-) lead and the probe tip needs to touch the (+) lead.

LTC3855EUJ

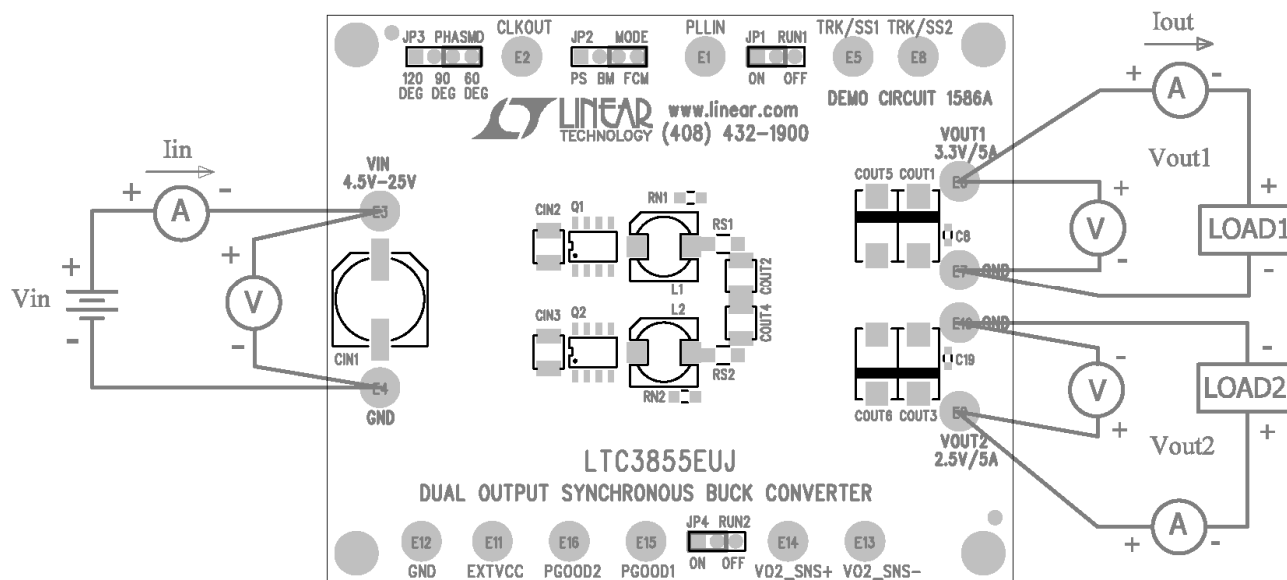


Figure 1. Proper Measurement Equipment Setup

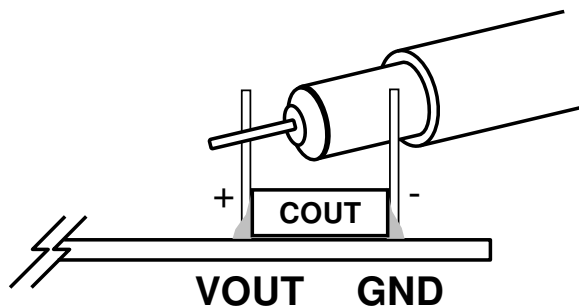


Figure 2. Measuring Output Voltage Ripple

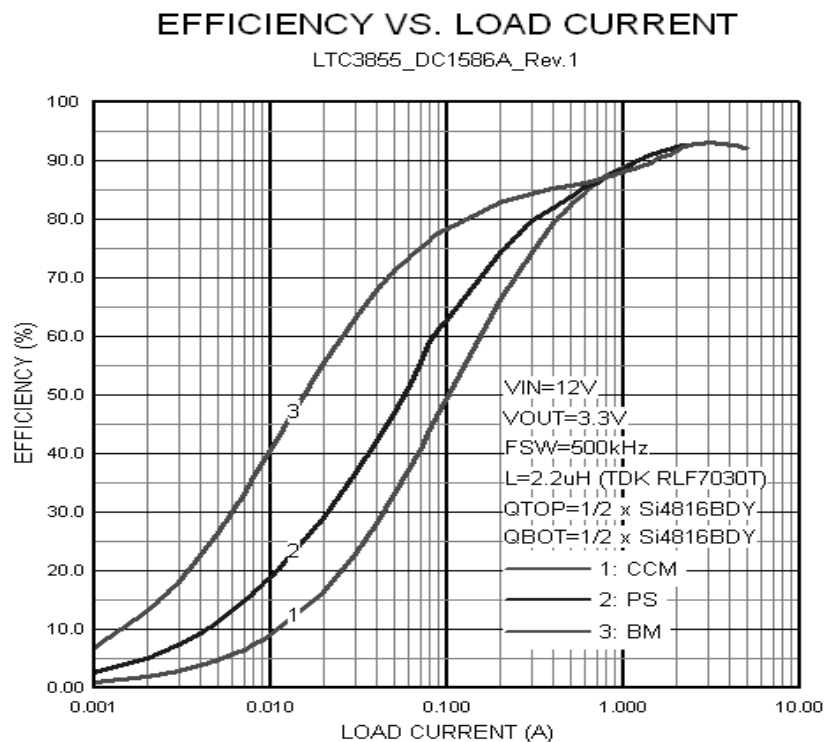


Figure 3. Efficiency vs load current For Vout1





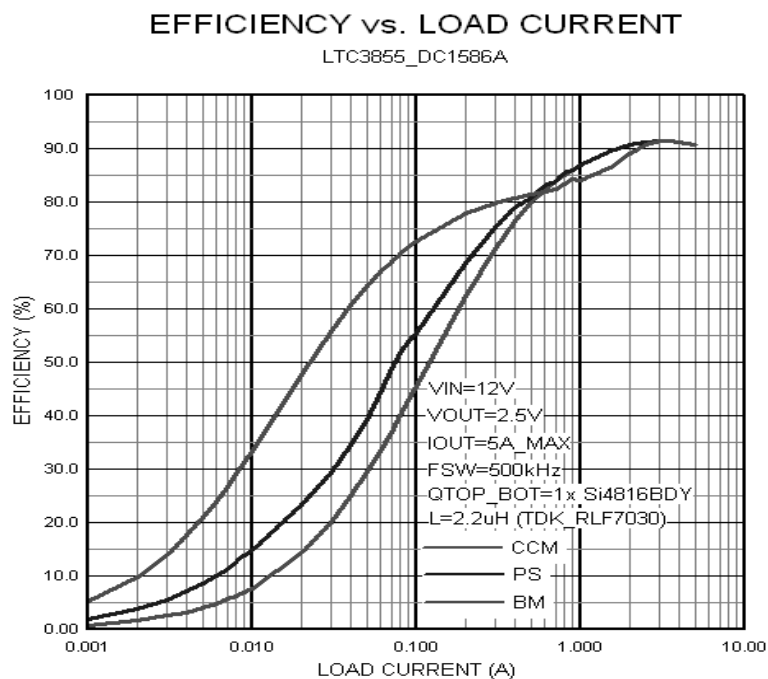


Figure 4. Efficiency vs load current For Vout2

LTC3855EUJ

REVISION HISTORY			
ECO	REV	DESCRIPTION	APPROVED DATE
	2	PRODUCTION	JAN/L 4-15-10

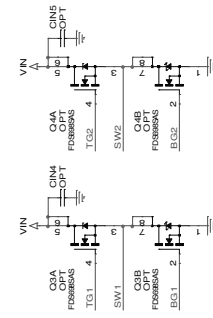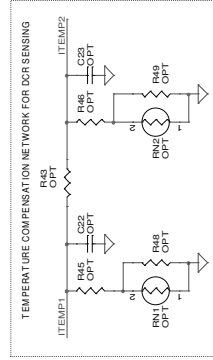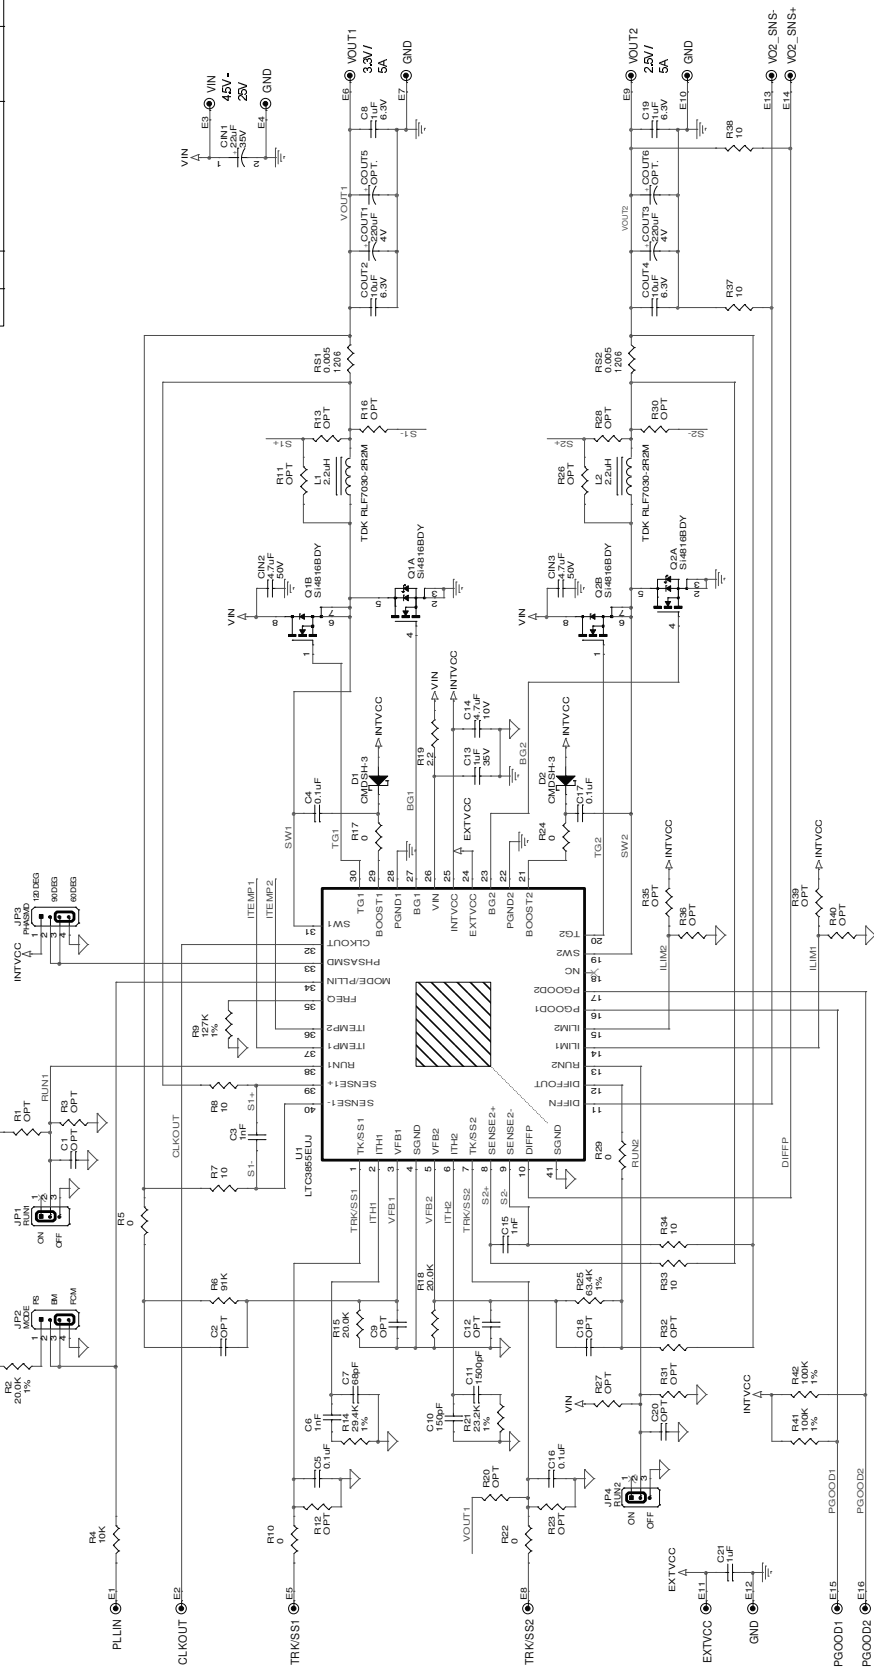

CUSTOMER NOTICE		CONTRACT NO.	
LINEAR TECHNOLOGY HAS MADE A BEST EFFORT TO DESIGN A CIRCUIT THAT MEETS CUSTOMER-SUPPLIED SPECIFICATIONS. HOWEVER, IT REMAINS THE CUSTOMER'S RESPONSIBILITY TO VERIFY PROPER AND RELIABLE OPERATION IN THE ACTUAL CIRCUIT. LOADS THAT MAY SIGNIFICANTLY AFFECT CIRCUIT PERFORMANCE OR RELIABILITY, CONTACT LINEAR TECHNOLOGY APPLICATIONS ENGINEERING FOR ASSISTANCE. THIS CIRCUIT IS PROPRIETARY TO LINEAR TECHNOLOGY AND SUPPLIED FOR USE WITH LINEAR TECHNOLOGY PARTS.		APPROVALS	
		POB DES: HZ	
		ENL: JAN/L	
		TITLE: SCHEMATIC	
		DUAL OUTPUT SYNCHRONOUS BUCK CONVERTER	
		REV: 2	
		SHEET: 1 OF 1	

Данный компонент на территории Российской Федерации

Вы можете приобрести в компании MosChip.

Для оперативного оформления запроса Вам необходимо перейти по данной ссылке:

<http://moschip.ru/get-element>

Вы можете разместить у нас заказ для любого Вашего проекта, будь то серийное производство или разработка единичного прибора.

В нашем ассортименте представлены ведущие мировые производители активных и пассивных электронных компонентов.

Нашей специализацией является поставка электронной компонентной базы двойного назначения, продукции таких производителей как XILINX, Intel (ex.ALTERA), Vicor, Microchip, Texas Instruments, Analog Devices, Mini-Circuits, Amphenol, Glenair.

Сотрудничество с глобальными дистрибьюторами электронных компонентов, предоставляет возможность заказывать и получать с международных складов практически любой перечень компонентов в оптимальные для Вас сроки.

На всех этапах разработки и производства наши партнеры могут получить квалифицированную поддержку опытных инженеров.

Система менеджмента качества компании отвечает требованиям в соответствии с ГОСТ Р ИСО 9001, ГОСТ РВ 0015-002 и ЭС РД 009

Офис по работе с юридическими лицами:

105318, г.Москва, ул.Щербаковская д.3, офис 1107, 1118, ДЦ «Щербаковский»

Телефон: +7 495 668-12-70 (многоканальный)

Факс: +7 495 668-12-70 (доб.304)

E-mail: info@moschip.ru

Skype отдела продаж:

moschip.ru

moschip.ru_4

moschip.ru_6

moschip.ru_9