

PC-Series

PC-Series

GFCI/ELCI & PANEL SEAL

The PC-Series, AC Residual Current Circuit Breaker with Overcurrent Protection (RCBO), combines the ground fault protection of a GFCI with the familiar overcurrent tripping characteristics of a normal circuit breaker. It detects lower level ground faults that do not trip ordinary circuit breakers, but could lead to shock hazards and fires in installations near water. Innovative features include status LED indicators distinguishing if a breaker is closed with line voltage present, or has opened due to leakage current, or has opened due to over current, or is closed with no line voltage present.



Resources:

[Configure a Complete Part](#)

[Download CAD & Sales Drawing >](#)

Product Highlights:

- Meets latest UL 943 standards
- GFCI self-test auto-monitoring & end-of-life indication
- Integrated push-to-reset button
- Overload, short circuit and ground fault protection in a single package
- Status LED indicators
- Single circuit solution for AC branch ground fault protection
- Optional panel seal

Typical Applications:

- Generators
- Water Heaters
- Battery Chargers
- Marine
- AC main ground fault protection for a boat's entire AC electrical system



Carling Technologies®

Innovative Designs. Powerful Solutions.

Carling Technologies, Inc.

60 Johnson Avenue, Plainville, CT 06062

Email: sales@carlingtech.com

Application Support: team2@carlingtech.com

Phone: 860.793.9281 Fax: 860.793.9231

www.carlingtech.com

PC-Series Switch

DESIGN FEATURES

MOUNTING PLATE

Available in stainless steel or zinc chromate plated carbon steel




OPTIONAL SEAL

IP66/67 panel seals provide ideal protection against salt spray, ozone, dust, water and most acids



LEDs

Two separate lights that indicate power, ground fault leakage and end-of-life

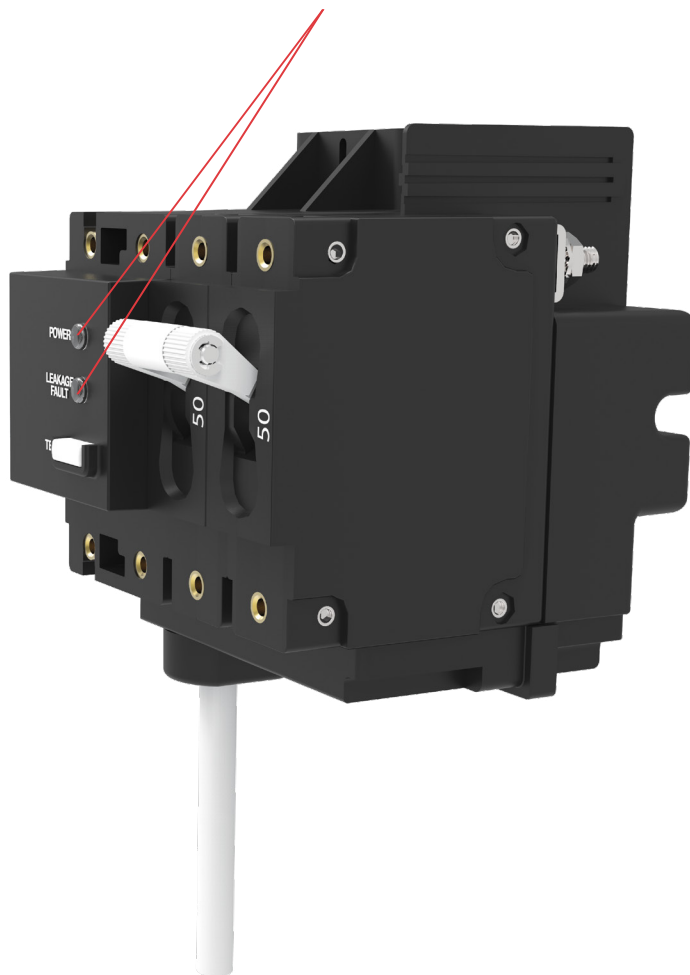

*Manufacturer reserves the right to change product specification without prior notice.

Electrical Tables

Table A: UL Listed & CSA Certified configurations as a Ground Fault Circuit Interruptor

| PC-SERIES TABLE A: UL Listed / CSA 22.2 No. 144.1 Configurations as a Ground Fault Circuit Interruptor | | | | | | | |
|--|------------|-------------------|-------|-----------------------|-------------------------------|-------------------------------------|---|
| Circuit Configuration | Voltage | | | Current Rating (Amps) | Short Circuit Capacity (Amps) | Ground Fault Trip Level (Milliamps) | Notes |
| | Max Rating | Frequency (Hertz) | Phase | | | | |
| Series | 120 | 60 | 1 | 1 - 50 | 5000 | 6 | 1 or 2 Poles. One pole of a two pole unit must be Neutral |
| | 120 / 240 | 60 | 1 | 1 - 50 | 5000 | 6 | 2 or 3 Poles. One pole of a three pole unit must be Neutral |

Table B: UL Recognized as an Earth Leakage Circuit Interruptor - 120 and 120/240V

| PC-SERIES TABLE B: UL Recognized Configurations as an Earth Leakage Circuit Interruptor | | | | | | | |
|---|------------|-------------------|-------|-----------------------|-------------------------------|-------------------------------------|---|
| Circuit Configuration | Voltage | | | Current Rating (Amps) | Short Circuit Capacity (Amps) | Ground Fault Trip Level (Milliamps) | Notes |
| | Max Rating | Frequency (Hertz) | Phase | | | | |
| Series | 120 | 50 / 60 | 1 | 1 - 50 | 5000 | 30 | 1 or 2 Poles. One pole of a two pole unit must be Neutral |
| | 120 / 240 | 50 / 60 | 1 | 1 - 50 | 5000 | 30 | 2 or 3 Poles. One pole of a three pole unit must be Neutral |
| Series Ignition Protection | 120 | 50 / 60 | 1 | 1 - 50 | 3000 | 30 | 1 or 2 Poles. One pole of a two pole unit must be Neutral |
| | 120 / 240 | 50 / 60 | 1 | 1 - 50 | 5000 | 30 | 2 or 3 Poles. One pole of a three pole unit must be Neutral |

Table C: UL Recognized as an Earth Leakage Circuit Interruptor - 240V

| PC-SERIES TABLE C: UL Recognized Configurations as an Earth Leakage Circuit Interruptor - 240V | | | | | | | |
|--|------------|-------------------|-------|-----------------------|-------------------------------|-------------------------------------|--|
| Circuit Configuration | Voltage | | | Current Rating (Amps) | Short Circuit Capacity (Amps) | Ground Fault Trip Level (Milliamps) | Notes |
| | Max Rating | Frequency (Hertz) | Phase | | | | |
| Series | 240 | 50 / 60 | 1 | 1 - 30 | 5000 | 30 | 2 or 3 Poles. One pole of a three pole unit must be Neutral. Suffix 11 |
| Series Ignition Protection | 240 | 50 / 60 | 1 | 1 - 50 | 5000 | 30 | 2 or 3 Poles. One pole of a three pole unit must be Neutral. Suffix 12 |

Impedance (Across Circuit breaker only)

RESISTANCE, IMPEDANCE VALUES
from Line to Load Terminals
(Values Based on Series Trip Circuit Braker)



| CURRENT (AMPS) | TOLERANCE (%) |
|----------------|---------------|
| 0.10 - 5.0 | ± 15 |
| 5.10 - 20.0 | ± 25 |
| 20.10 - 50.0 | ± 35 |

Agency Certifications

UL Standard 489

UL Standard 1077

UL Standard 943 & CSA 22.2 No. 144.1

UL Standard 1053

UL Standard 1500

Circuit Breakers, Molded Case,
(Guide DIVQ, File E129899)

Supplementary Protectors

Class A Ground Fault Circuit Interrupters

Ground Fault Sensing and Relaying Equipment

Ignition Protection

Electrical

| | |
|----------------------------|--|
| Current Ratings | 50 Amps maximum |
| Voltage Rating | 120 VAC, 120/240 VAC |
| Dielectric Strength | 1480 VAC, 60Hz for 1 minute between all electrically isolated terminals |
| Insulation Resistance | Minimum of 100 Megohms at 500VDC |
| Leakage Current Trip Level | 5±1 mA |
| Leakage Current Trip Time | ≤ 25 ms complies with UL 943 |
| EMI | UL 943 / IEC 61000-4-6, 0.5V 150KHz ~ 230 MHz |
| Operating Frequency | 50/60 Hz |
| Reverse Polarity | A reversed Line / Load connection to the circuit breaker shall not cause damage to the device |
| Grounded Neutral | When neutral is grounded on load side of circuit |
| Overload | 50 operations @ 600% of rated current on Breakers |
| Switched Neutral | 2nd Pole on 120V and 3rd Pole on 120/240V, Optional |
| Manual Test | To be performed at least every month by pressing the test button on the GFCI to verify the device's ability to respond and trip when subjected to simulated leakage. Current imbalance is sufficient to cause tripping at 85% of rated voltage. Line Power at L1 is required. |
| GFCI Auto-Monitoring | Performed automatically without opening circuit breaker contacts or compromising ability to respond to ground or neutral faults. Automatic Self-Test performed automatically every time power is supplied within 5 seconds. Automatic Self-Test Frequency: 3 seconds. Line Power at L1 is required. Feedback when auto-monitoring Self-Test fails: Circuit breaker trips and cannot be reset and a visual indication is displayed (See Next Page). |
| GFCI Heartbeat Indicator | Successful Self Tests are followed by a flash of light per Next Page |
| GFCI End of Life | Circuit breaker trips and cannot be reset. A visual indication is displayed via the LED's located on the front of the device (See Next Page). Line Power at L1 is required. |

Mechanical

| | |
|-----------|--|
| Endurance | 10,000 "On-Off" Operations at 6 per minute; 6000 with Rated Current & Voltage (3000 test button and 3000 manual operations) and 4000 on/off operations with no load. |
| Trip Free | Trips on short circuit, overload or leakage to ground, even when actuator is forcibly held in the "On" position |

Physical

| | |
|------------------------|--|
| Number of Poles | 1-pole (1 Circuit Breaker + 1 GFCI Sensor Module), 120V. 2-pole (2 Circuit Breakers + 1 GFCI Sensor Module), 120/240V or 120V with Switched Neutral. 3-pole (3 Circuit Breakers + 1 GFCI Sensor Module), 120/240V with Switched Neutral. |
| Termination | Circuit Breaker Line Side: #10-32 GFCI Sensor Module Load Side: #10-32. Neutral pigtail provided with non-switched neutral units. |
| Mounting | Front Panel, #6-32 or M3 threaded inserts. |
| Actuator | Handle, Flat Rocker, Curved Rocker (with or without rocker guard), Push-to-Reset Rocker |
| Internal Configuration | Circuit Breaker, Series Trip Switch only (without over-current protection) |
| Weight | 1-pole: approximately 300 grams (10.6 ounces) 2-pole: approximately 375 grams (13.2 ounces) 3-pole: approximately 500 grams (17.6 ounces) |
| Standard Colors | Housing – Black, Test Button – White, Text – White |

Environmental

| | |
|--|---|
| Designed and tested in accordance with requirements of specification MIL-PRF- 55629 and MIL-STD-202G as follows: | |
| Shock | Withstands 100 G, 6ms, sawtooth at rated current per Method 213, Test Condition "I". |
| Thermal Shock | Method 107D, Condition A (5-cycle at -55°C to +25°C to +85°C to +25°C) |
| Vibration | Withstands 0.06" excursion from 10-55 Hz, and 10 G 55-500 Hz, at rated current per Method 204C, Test Condition A. Instantaneous & ultrashort curves tested at 90% of rated current. |
| Moisture Resistance | 93% RH at 30°C for 168 Hours. |
| Operating Temperature | -35°C to +66°C |
| Corrosion | UL-943-6.21, 3 weeks Humidity: 30±2°C, 70±2% relative humidity Mixed Flowing Gases: 100 ppb H ₂ S, 20 ppb Cl ₂ , 200±50 ppb NO ₂ |

GFCI LED Indication

| Condition | Breaker | LED Output |
|-----------------------------|------------|---|
| Power with Open Circuit | Open | None |
| Circuit Manually Opened | Open | None |
| Power with Closed Circuit | Closed | Green (solid) |
| Ground Fault Leakage | Trips Open | Red (solid) |
| Grounded Neutral | Trips Open | Red (solid) |
| Passed Automatic, Self-Test | Closed | Red (flash lasting 2 ms, every 3 seconds) |
| Failed Automatic, Self-Test | Trips Open | Red (continuous flashing, every 0.10 seconds) |
| Manual GFCI Monthly Test | Trips Open | Red (solid) |
| Over Current | Trips Open | None |
| End of Life | Trips Open | Red (continuous flashing, every 0.10 seconds) |

Loss of line power results in no LED output and no continuous trip

GFCI Test Instructions

1. Turn "OFF" the GFCI Breaker actuator. Turn on the power to the panel. The green and red LED's should be off.
2. Turn "ON" the GFCI Breaker actuator. The green "POWER" LED should show steady illumination and the red "LEAKAGE FAULT" LED should flash every 3 seconds to indicate a successful self-test.
3. Depress the "TEST" button. This will cause the actuator to move to the "OFF" position and the red LED to turn on and show steady illumination, indicating that the GFCI is functioning properly. The green LED will also go from steady to off. If the actuator fails to move to the "OFF" position or the red LED fails to illuminate, the unit MUST be replaced.
4. Turn the GFCI Breaker actuator to the "ON" position. The red LED should flash every 3 seconds and the green LED should show steady illumination.
5. This test is to be performed on a monthly basis and recorded on the "Monthly Test Reminder" label.


ELCI LED Indication

Indicator - Two integrated LEDs, Red & Green

- Green LED On, Red LED Off - Line Voltage is present, the breaker is closed, and the device is protecting the circuits against over current and leakage current.
- Green LED Off, Red LED On - The device has detected leakage current and has opened the circuit breaker.
- Green LED Flashing, Red LED Off - The circuit breaker has opened due to over current or has been turned off manually
- Green LED Off, Red LED Off - Line Voltage is not present
- Green LED Flashing, Red LED Off, Amber LED ON - Indicates Hot & Neutral are reversed and the circuit breaker is open

Neutral Protection - When neutral is grounded on load side of circuit

Test Button - Located on Ground Fault Module

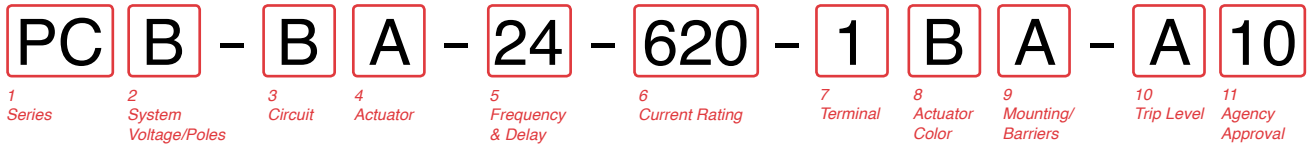

1 SERIES
PC

2 SYSTEM VOLTAGE / POLES 4
A 120 VAC single phase, 1 pole
B 120/240 VAC single phase, 2 pole
C 120/240 VAC single phase with switched neutral, 3 pole
D 120 VAC single phase with switched neutral, 2 pole
G 240 VAC single phase, 2 pole

3 CIRCUIT
B Series Trip (Current)

4 ACTUATOR
Handle
A 1 per breaker pole
B 1 per unit
Two Color Curved Visi-Rocker
C Indicate ON, vertical legend
D Indicate ON, horizontal legend
F Indicate OFF, vertical legend
G Indicate OFF, horizontal legend
Single Color Curved Rocker
J Vertical legend
K Horizontal legend
Two Color Curved Visi-Rocker Push-to-Reset
N Indicate OFF, Vertical legend
O Indicate OFF, Horizontal legend

Single Color Curved Rocker Push-to-Reset
R Vertical legend
U Horizontal legend
Two Color Flat Visi-Rocker
1 Indicate OFF, vertical legend
2 Indicate OFF, horizontal legend
Single Color Flat Rocker
3 Vertical legend
4 Horizontal legend
Two Color Flat Visi-Rocker Push-to-Reset
5 Indicate OFF, vertical legend
6 Indicate OFF, horizontal legend
Single Color Flat Rocker Push-to-Reset
7 Vertical legend
8 Horizontal legend

| ROCKER STYLE DESCRIPTIONS | | | | | |
|---------------------------|--|-----------------------|-----------------------|--|-----------------------|
| | INDICATE "ON" | INDICATE "OFF" | SINGLE COLOR | INDICATE "OFF" | SINGLE COLOR |
| VERTICAL STYLE | LINE CODE "C", "N" INDICATE COLOR LOCATION | LINE CODE "F", "U" | LINE CODE "J", "R" | LINE CODE "1", "5" INDICATE COLOR LOCATION | LINE CODE "3", "7" |
| | LINE CODE "D" | LINE CODE "G", "O" | LINE CODE "K", "U" | LINE CODE "2", "6" | LINE CODE "4", "8" |
| HORIZONTAL STYLE | LINE CODE "D" | LINE CODE "G", "O" | LINE CODE "K", "U" | LINE CODE "2", "6" | LINE CODE "4", "8" |

5 FREQUENCY & DELAY
20 50 / 60Hz Instantaneous
21 50 / 60Hz Ultra Short
22 50 / 60Hz Short
24 50 / 60Hz Medium
26 50 / 60Hz Long

6 CURRENT RATING (AMPERES)

| CODE | AMPERES | CODE | AMPERES | CODE | AMPERES | CODE | AMPERES |
|------|---------|------|---------|------|---------|------|---------|
| 410 | 1.000 | 445 | 4.500 | 610 | 10.000 | 618 | 18.000 |
| 512 | 1.250 | 450 | 5.000 | 710 | 10.500 | 620 | 20.000 |
| 415 | 1.500 | 455 | 5.500 | 611 | 11.000 | 622 | 22.000 |
| 517 | 1.750 | 460 | 6.000 | 711 | 11.500 | 624 | 24.000 |
| 420 | 2.000 | 465 | 6.500 | 612 | 12.000 | 625 | 25.000 |
| 522 | 2.250 | 470 | 7.000 | 712 | 12.500 | 630 | 30.000 |
| 425 | 2.500 | 475 | 7.500 | 613 | 13.000 | 635 | 35.000 |
| 527 | 2.750 | 480 | 8.000 | 614 | 14.000 | 640 | 40.000 |
| 430 | 3.000 | 485 | 8.500 | 615 | 15.000 | 650 | 50.000 |
| 435 | 3.500 | 490 | 9.000 | 616 | 16.000 | | |
| 440 | 4.000 | 495 | 9.500 | 617 | 17.000 | | |

7 TERMINAL
1 Stud, 10-32 threaded

8 ACTUATOR COLOR & LEGEND

| Handle Actuator Color | I-O | ON-OFF | Dual | Single | Rocker Actuator Color | Visi-Rocker |
|-----------------------|-----|--------|------|--------|-----------------------|-------------|
| White | A | B | 1 | Black | White | White |
| Black | C | D | 2 | White | N/A | N/A |
| Red | F | G | 3 | White | Red | Red |
| Green | H | J | 4 | White | Green | Green |
| Blue | K | L | 5 | White | Blue | Blue |
| Yellow | M | N | 6 | Black | Yellow | Yellow |
| Gray | P | Q | 7 | Black | Gray | Gray |
| Orange | R | S | 8 | Black | Orange | Orange |

9 MOUNTING / BARRIERS

| Actuator Color | MOUNTING STYLE | BARRIERS |
|----------------|--|----------|
| A | 6-32 X 0.195 inches Threaded Insert, 2 per pole | yes |
| | ISO M3 x 5mm Rockerguard Bezel | yes |
| C | 6-32 X 0.195 inches Threaded Insert, 2 per pole | yes |
| | ISO M3 x 5mm Standard Bezel with Recessed Off-Side Flat Rocker | yes |
| E | 6-32 X 0.195 inches Threaded Insert, 2 per pole | yes |
| | ISO M3 x 5mm Push-to-Reset Bezel | yes |
| G | 6-32 X 0.195 inches Threaded Insert, 2 per pole | yes |
| | ISO M3 x 5mm | yes |

10 LEAKAGE CURRENT TRIP LEVEL - MAX. TRIP CURRENT
A 6 MA (CLASS A GFCI) ²
E 30 MA (ELCI) ^{1,3}

11 AGENCY APPROVAL
AA without Approvals
10 UL 943 and CSA certified ²
11 UL 1053 ^{1,3}
12 UL 1053 & UL 1500 ^{1,3}

Notes:
 1 This device meets the requirements of ABCY E11.
 2 6mA per UL943, available with agency code 10.
 3 30mA per UL1053, available with agency approval codes 11 & 12.
 4 Agency approval code 10 only available with system voltages A, B, C and D.




Dimensional Specifications: in. [mm]

INDICATE OFF / SINGLE COLOR
ROCKER ACTUATOR




HANDLE / INDICATE ON
ROCKER ACTUATOR

TERMINAL
LOCATIONS




PCA
120 VAC
VERSION

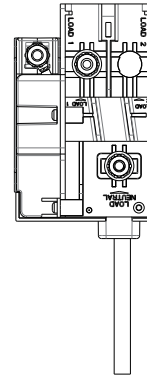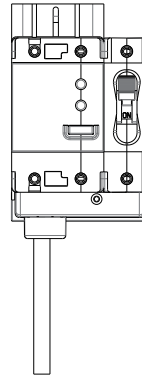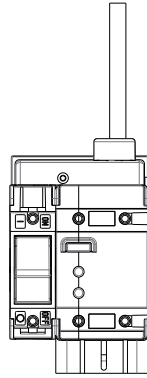




PCB
120/240 VAC
VERSION

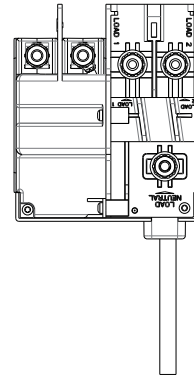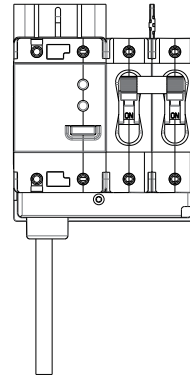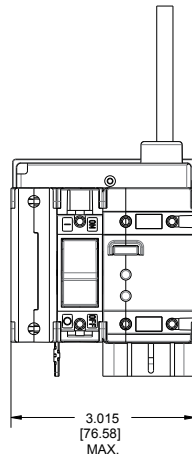

PCC
120/240 VAC
VERSION
W/ NEUTRAL BREAK

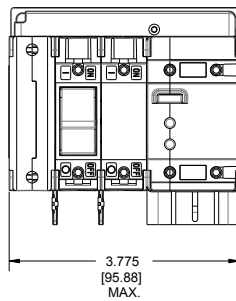

PCD
120 VAC
VERSION
W/NEUTRAL BREAK





Dimensional Specifications: in. [mm]

NOTE: NEUTRAL - SUPPLIED 12" LONG MIN. (CIRCUIT CODES A,B,E & F)



PANEL CUTOUT DETAIL
TOLERANCES ±.005 [12]

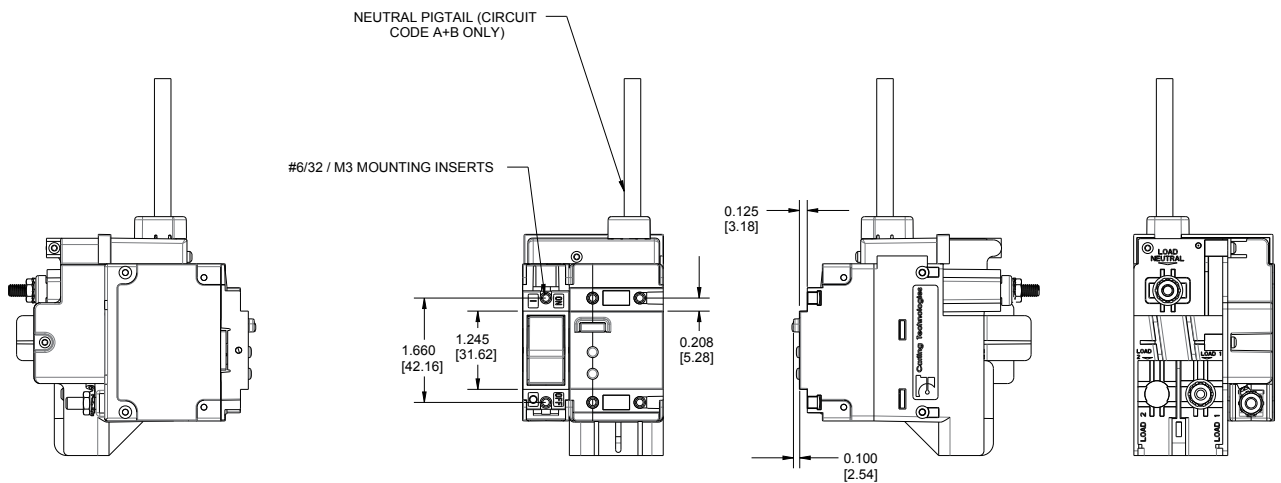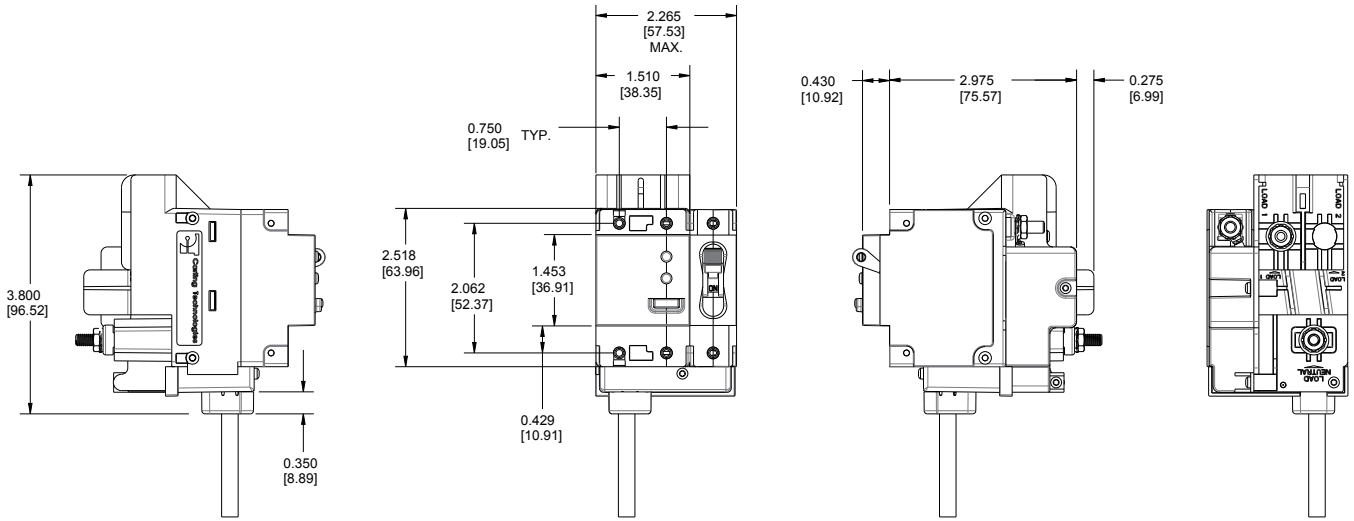

Notes:
For additional circuit breaker dimensions, reference the C-Series Breakers in the Carling Circuit Protection catalog

8 **PC** - **1** **4** **1**

¹ Type Number ² Series ³ Actuator ⁴ Poles ⁵ Mounting

1 TYPE NUMBER
8 Circuit Breaker Assembly

2 SERIES
PC



3 ACTUATOR TYPE
1 Handle, one per pole
2 Handle, one per multipole unit
A Rocker

4 POLES PER UNIT - INCLUDING ELECTRONIC MODULE
3 Three
4 Four
5 Five



5 MOUNTING SCREWS / PLATE MATERIAL ¹
1 6-32 Thread Phillips Head
2 M-3 Thread Phillips Head
3 6-32 Thread Slotted Head
4 M-3 Thread Slotted Head
5 6-32 Thread Phillips Head with Stainless Steel Plate
6 M-3 Thread Phillips Head with Stainless Steel Plate
7 6-32 Thread Slotted Head with Stainless Steel Plate
8 M-3 Thread Slotted Head with Stainless Steel Plate

Notes:
1 Screws supplied to accommodate mounting panel thickness of 1/8" ± 1/32". Consult Factory for additional options
2 Available for Flat and Curved Rocker options - No Rockerguard Bracket

Handle Style Panel Seal

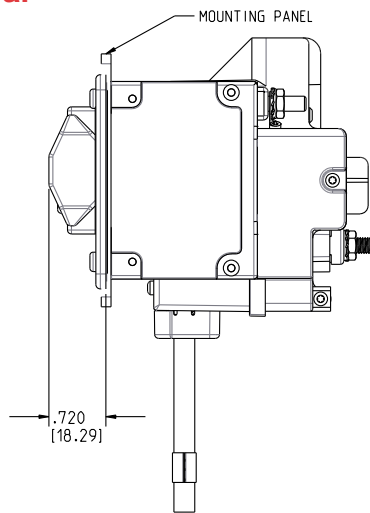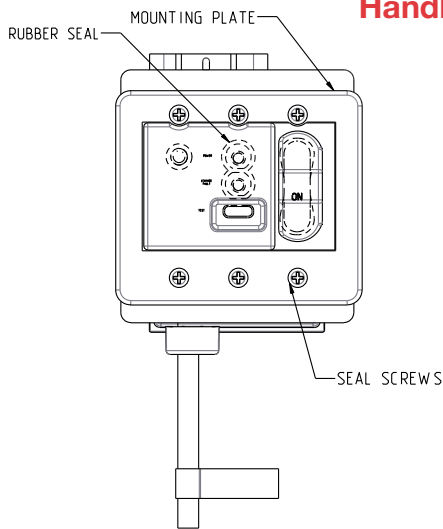

Rocker Style Panel Seal

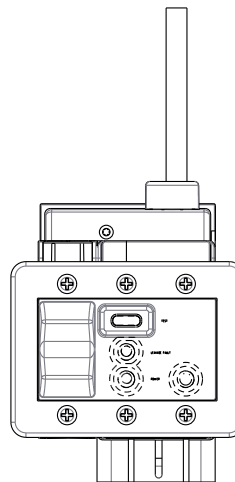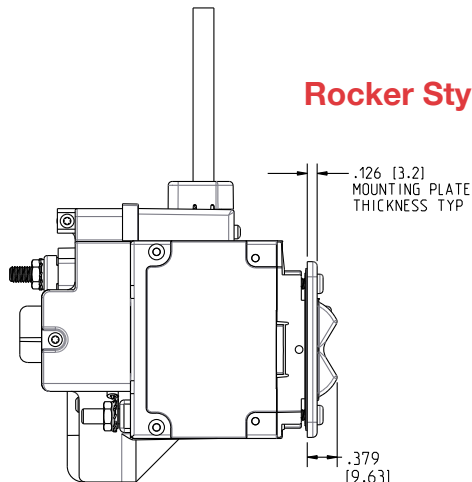


Handle Actuator




Rocker Actuator




Time Delay Curves Instantaneous

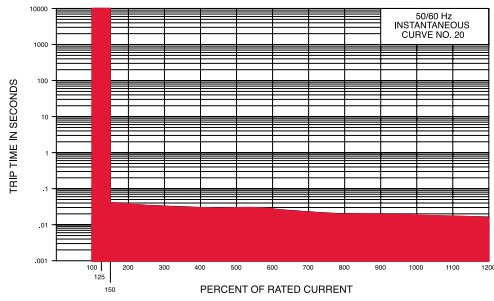


Medium

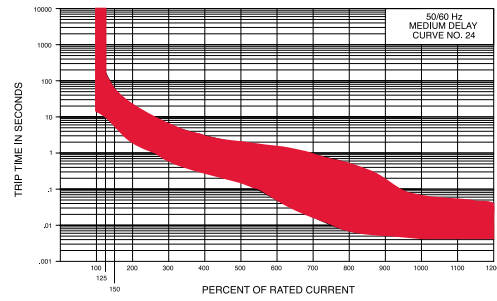


Ultra Short

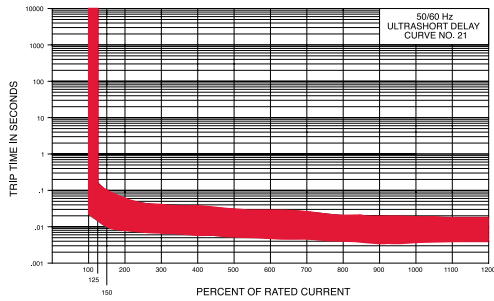

Long

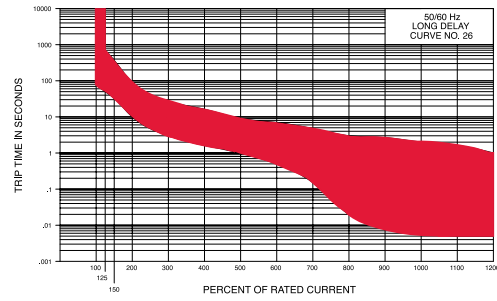

Short

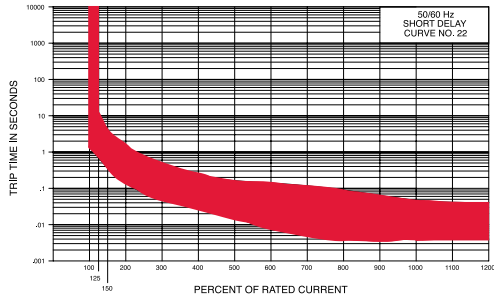

| Time Delay Values | | | | | | | | | |
|--------------------------|---------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
| Percent of Rated Current | | | | | | | | | |
| Delay | 100% | 125% | 150% | 200% | 400% | 600% | 800% | 1000% | 1200% |
| 20 | No Trip | May Trip | .040 MAX | .035 MAX | .030 MAX | .025 MAX | .020 MAX | .017 MAX | .015 MAX |
| 21 | No Trip | .014 - .150 | .011 - .095 | .008 - .055 | .006 - .035 | .005 - .027 | .005 - .021 | .004 - .018 | .004 - .017 |
| 22 | No Trip | .700 - 12.0 | .350 - 4.00 | .130 - 1.30 | .027 - .220 | .008 - .130 | .004 - .090 | .004 - .045 | .004 - .040 |
| 24 | No Trip | 10.0 - 160 | 6.00 - 60.0 | 2.20 - 20.0 | .300 - 3.00 | .050 - 1.30 | .007 - .500 | .005 - .060 | .005 - .040 |
| 26 | No Trip | 50.0 - 700 | 32.0 - 350 | 10.0 - 90.0 | 1.50 - 15.0 | .500 - 7.00 | .020 - 3.00 | .006 - 2.00 | .005 - 1.00 |

Notes:

Other time delay values available, consult factory.

Delay Curves 21,22,24,26: Breakers to hold 100% and must trip at 125% of rated current and greater within the time limit shown in this curve.

Delay Curve 20: Breakers to hold 100% and must trip at 150% of rated current and greater within the time limit shown in this curve.

All Curves: Curve data shown represents breaker response at ambient temperature of 77°F (25°C) with no preloading. Breakers are mounted in standard wall-mount position.

The minimum inrush pulse tolerance handling capability is 12 times the rated current. These values are based on a 60 Hz 1/2 cycle, 8.33 ms pulse.

Authorized Sales Representatives and Distributors

Click on a region of the map below to find your local representatives and distributors or visit www.carlingtech.com/findarep.



About Carling

Founded in 1920, Carling Technologies is a leading manufacturer of electrical and electronic switches and assemblies, circuit breakers, electronic controls, power distribution units, and multiplexed power distribution systems. With four ISO registered manufacturing facilities and technical sales offices worldwide, Carling Technologies Sales, Service and Engineering teams do much more than manufacture electrical components, they engineer powerful solutions! To learn more about Carling please visit www.carlingtech.com/company-profile.

To view all of Carling's environmental, quality, health & safety certifications please visit www.carlingtech.com/environmental-certifications

Worldwide Headquarters

Carling Technologies, Inc.
60 Johnson Avenue, Plainville, CT 06062
Phone: 860.793.9281 **Fax:** 860.793.9231
Email: sales@carlingtech.com

Northern Region Sales Office: nrsm@carlingtech.com
Southeast Region Sales Office: sersm@carlingtech.com
Midwest Region Sales Office: mrsm@carlingtech.com
West Region Sales Office: wrsm@carlingtech.com
Latin America Sales Office: larsm@carlingtech.com

Asia-Pacific Headquarters

Carling Technologies, Asia-Pacific Ltd.,
Suite 1607, 16/F Tower 2, The Gateway,
Harbour City, 25 Canton Road,
Tsimshatsui, Kowloon, Hong Kong
Phone: Int + 852-2737-2277 **Fax:** Int + 852-2736-9332
Email: sales@carlingtech.com.hk

Shenzhen, China: shenzhen@carlingtech.com
Shanghai, China: shanghai@carlingtech.com
Pune, India: india@carlingtech.com
Kaohsiung, Taiwan: taiwan@carlingtech.com
Yokohama, Japan: japan@carlingtech.com

Europe | Middle East | Africa Headquarters

Carling Technologies LTD
4 Airport Business Park, Exeter Airport,
Clyst Honiton, Exeter, Devon, EX5 2UL, UK
Phone: Int + 44 1392.364422 **Fax:** Int + 44 1392.364477
Email: ltd.sales@carlingtech.com

Germany: gmbh@carlingtech.com
France: sas@carlingtech.com



Carling Technologies®

Innovative Designs. Powerful Solutions.

Данный компонент на территории Российской Федерации

Вы можете приобрести в компании MosChip.

Для оперативного оформления запроса Вам необходимо перейти по данной ссылке:

<http://moschip.ru/get-element>

Вы можете разместить у нас заказ для любого Вашего проекта, будь то серийное производство или разработка единичного прибора.

В нашем ассортименте представлены ведущие мировые производители активных и пассивных электронных компонентов.

Нашей специализацией является поставка электронной компонентной базы двойного назначения, продукции таких производителей как XILINX, Intel (ex.ALTERA), Vicor, Microchip, Texas Instruments, Analog Devices, Mini-Circuits, Amphenol, Glenair.

Сотрудничество с глобальными дистрибьюторами электронных компонентов, предоставляет возможность заказывать и получать с международных складов практически любой перечень компонентов в оптимальные для Вас сроки.

На всех этапах разработки и производства наши партнеры могут получить квалифицированную поддержку опытных инженеров.

Система менеджмента качества компании отвечает требованиям в соответствии с ГОСТ Р ИСО 9001, ГОСТ РВ 0015-002 и ЭС РД 009

Офис по работе с юридическими лицами:

105318, г.Москва, ул.Щербаковская д.3, офис 1107, 1118, ДЦ «Щербаковский»

Телефон: +7 495 668-12-70 (многоканальный)

Факс: +7 495 668-12-70 (доб.304)

E-mail: info@moschip.ru

Skype отдела продаж:

moschip.ru

moschip.ru_4

moschip.ru_6

moschip.ru_9